

PH 95-01
AIT 18

DELIVERED

Delmarva Drilling Co., Inc.

P.O. BOX 188

BRIDGEVILLE, DELAWARE 19933

APR 4 1978
DELAWARE GEOLOGICAL SURVEY


Water Well Contractors

CUSTOMER Townsend's Inc. (Bay Farm) JOB 4134

ADDRESS Millsboro, Del.

LOCATION 65' off RT 299 DATE 11-16-77

Permit No. 39065

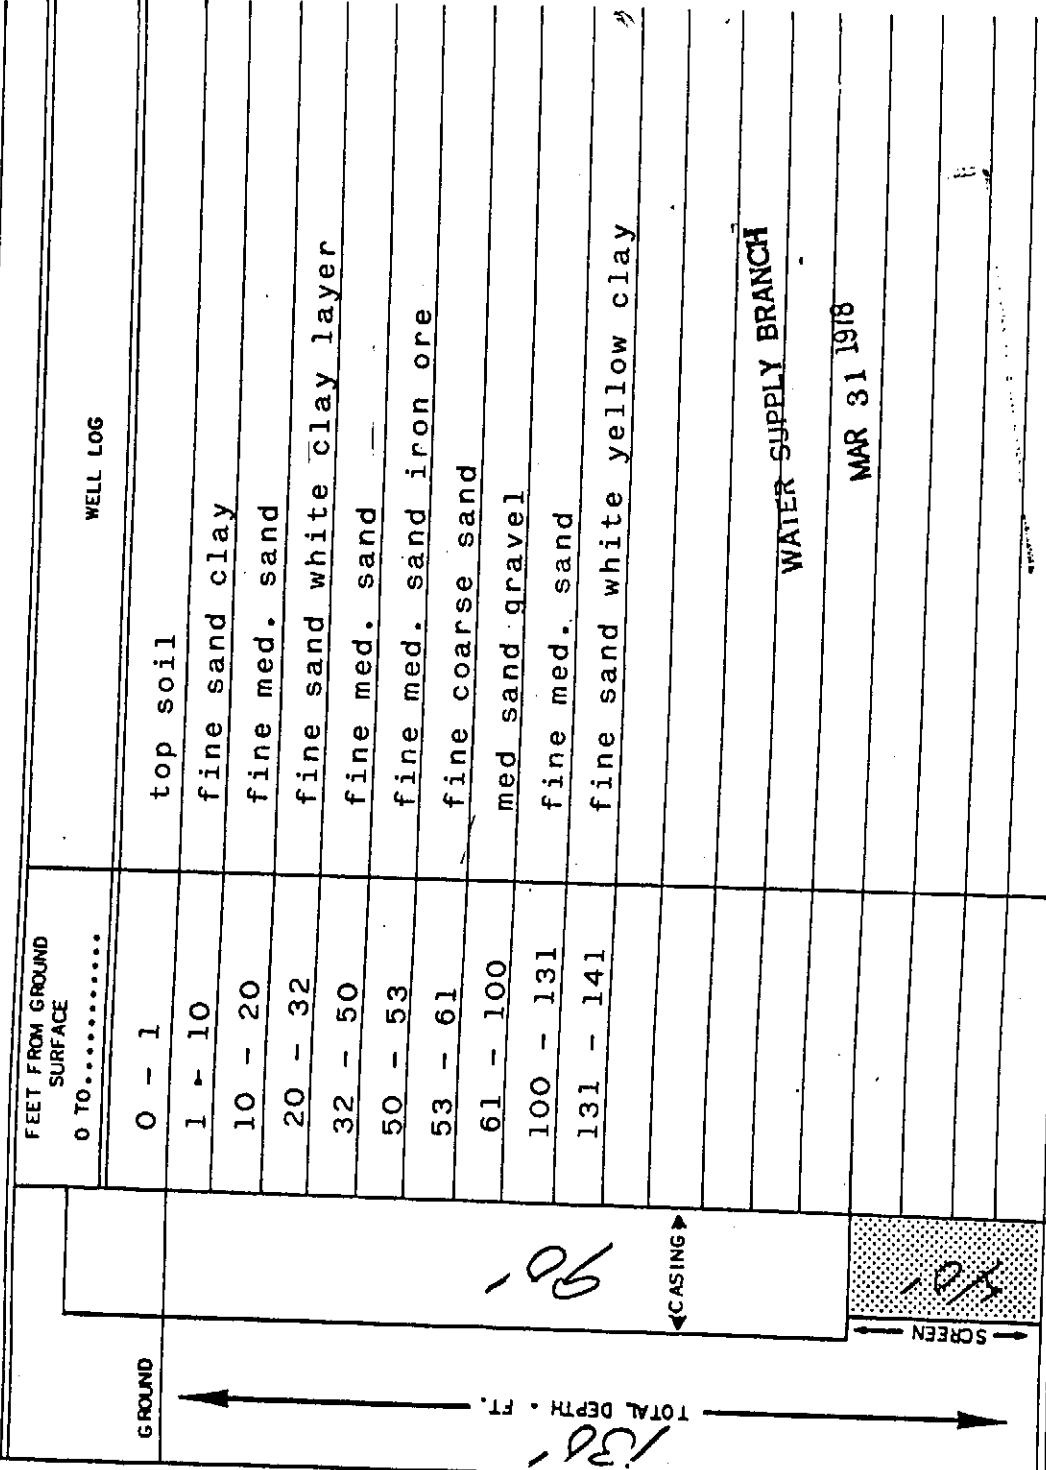

WELL NO. <u>1</u>	DIAMETER OF WELL <u>4"</u>	DEPT. OF WELL <u>130'</u>
HRS. PUMPED <u>2 1/2</u>	SLOT SIZE <u>.030</u>	TYPE OF CASING <u>PVC</u>
CAPACITY G.P.M. <u>60</u>	DRILLING MACHINE NO. <u>D2</u>	LENGTH OF CASING <u>90'</u>
STATIC LEVEL <u>10</u>	DRILLER <u>WhiteLock</u>	DISTANCE TO TOP OF SCREEN <u>90-130</u>
PUMPING LEVEL <u>13</u>	GRAVEL <u>2</u>	TYPE SCREEN <u>PVC</u>
SPECIFIC CAPACITY <u>20</u>	BAGS OF CEMENT	SIZE OF SCREEN <u>4"</u>
PUMPED WITH <u>air pumper</u>	DATE WELL COMPLETED <u>11-17-77</u>	
DEPTH OF CEMENT/GROUT CLAY <u>0-20</u>		
DEPTH GRAVEL PACKED <u>140-80</u>		

DRILLER'S HELPER D. Short Allen WhiteLock