



TEMPERATURE GAMMA RAY LOG


Company WELL WATER SYSTEMS, INC.
Well ASR TPW-1
Field ENGLEWOOD
Country CHARLOTTE
State/Prv FLORIDA

Location
ENGLEWOOD WATER DISTRICT
SOUTH REGIONAL WASTEWATER
TREATMENT PLANT

Other Services
NONE

Permanent Datum	G.L.	Elevation	na	Elevation
Log Measured From	G.L.			K.B. D.F. G.L.
Drilling Measured From	G.L.			

Date	22-MAR-2000						
Run Number	TWO						
Depth Driller	494' CMT PLUG						
Depth Logger	481' CMT PLUG						
Bottom Logged Interval	481'						
Top Log Interval	SURFACE						
Open Hole Size	na						
Type Fluid	WATER						
Density / Viscosity	na/na						
Max. Recorded Temp.	120 degF						
Estimated Cement Top	310'						
Time Well Ready	07:00 22-MAR-00						
Time Logger on Bottom	07:00 22-MAR-00						
Equipment Number	MVG-S-1						
Location	FT. MYERS						
Recorded By	MILLER/VINCENT						
Witnessed By	F. REVNOLDS (PBS&J)						
	B. NORRIS (WWS)						
Borehole Record							
Run Number	Bit	From	To	Size	Weight	From	To
ONE	7.875"	SURFACE	805'				
Tubing Record							
Casing Record	Size	Wgt/Ft	Top	Bottom			
Surface String	24"	375' WT	SURFACE	295'			
Prod. String	16"	375' WT	SURFACE	507'			
Production String							
Liner							
Inv. #	2000068						

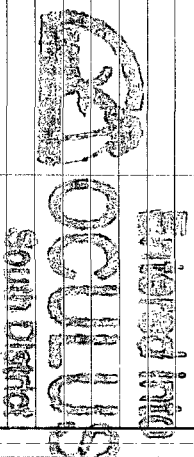

All interpretations are opinions based on inferences from electrical or other measurements and we cannot and do not guarantee the accuracy or correctness of any interpretation, and we shall not, except in the case of gross or willful negligence on our part, be liable or responsible for any loss, costs, damages, or expenses incurred or sustained by anyone resulting from any interpretation made by any of our officers, agents or employees. These interpretations are also subject to our general terms and conditions set out in our current Price Schedule.


Comments

ESTIMATED CEMENT TOP: 310'

Temperature Log was run 17 hrs after Pumped Stage.

TEMPERATURE CALIBRATION REPORT (performed: 14-MAR-00 15:15)

DEG-F	CPS
38.5	148.856
148.8	2690.25





Stage #2


Database File: engwasr1.db
 Dataset Pathname: pass1
 Presentation Format: rtstemp3.prs
 Dataset Creation: Wed Mar 22 07:28:53 2000 by Log VER_5.3
 Charted by: Depth in Feet scaled 1:240

* FINAL PRINT *

0	TEMP (degF)	150
0	GAMMA RAY (GAPI)	100
100	(in)	200


70	TEMP (degF)	120
-1	DELTA TEMP (degF)	1

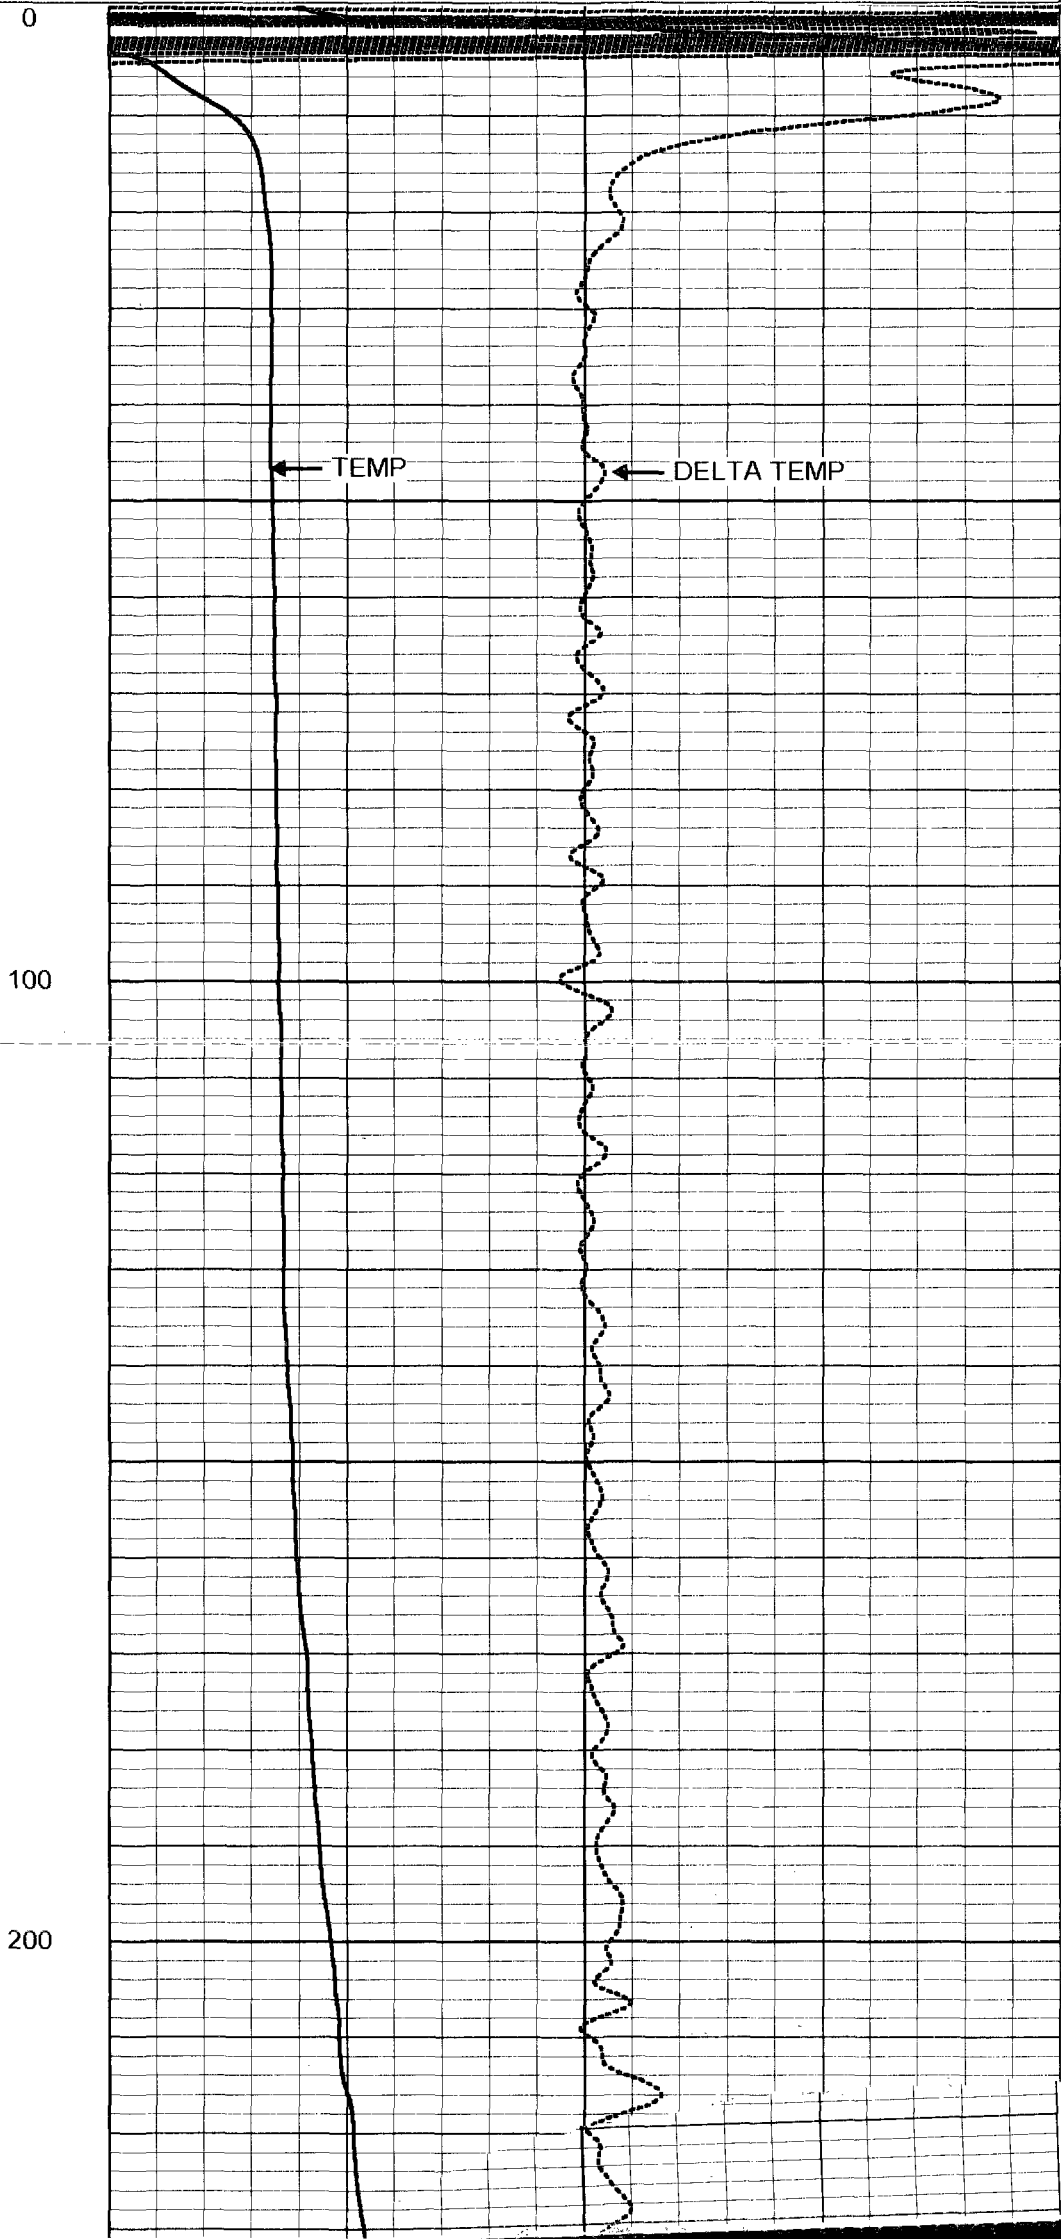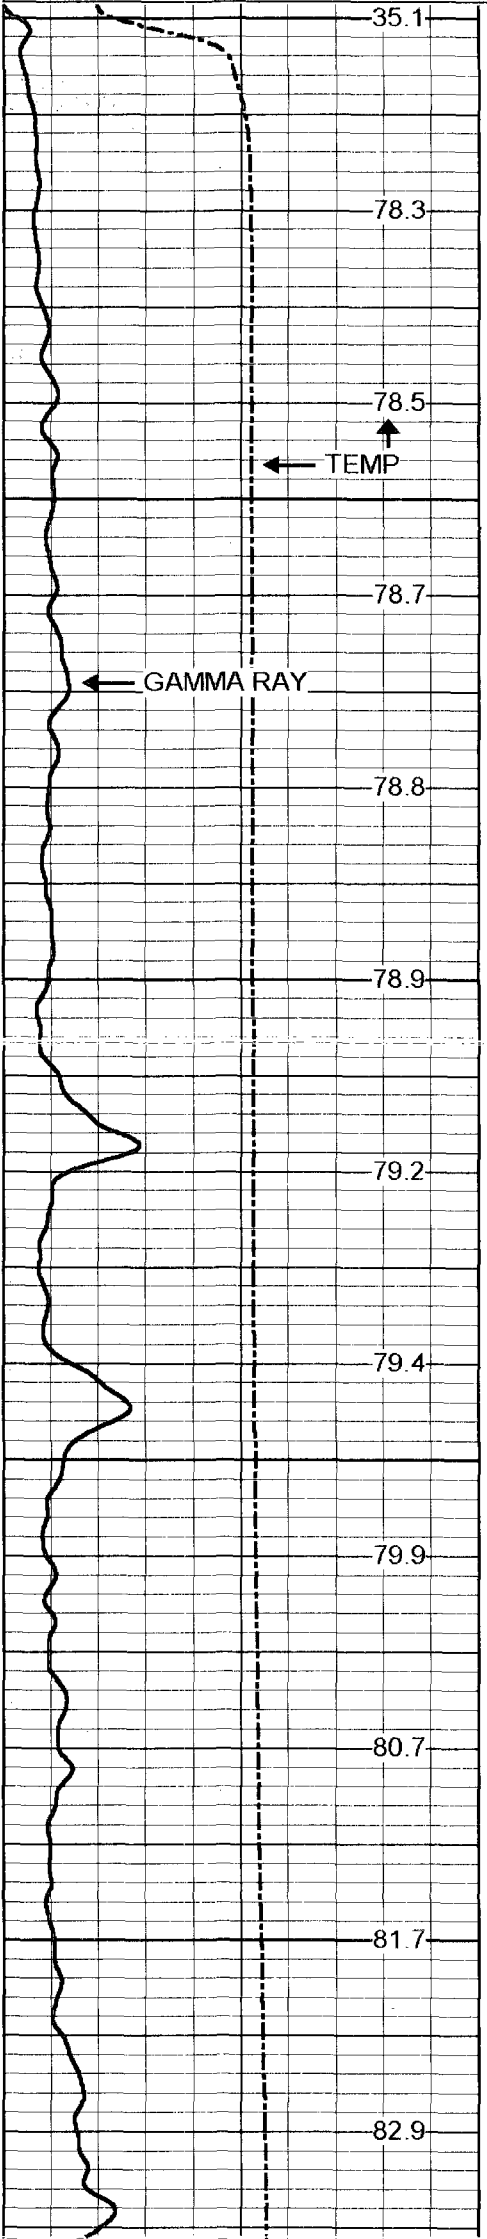


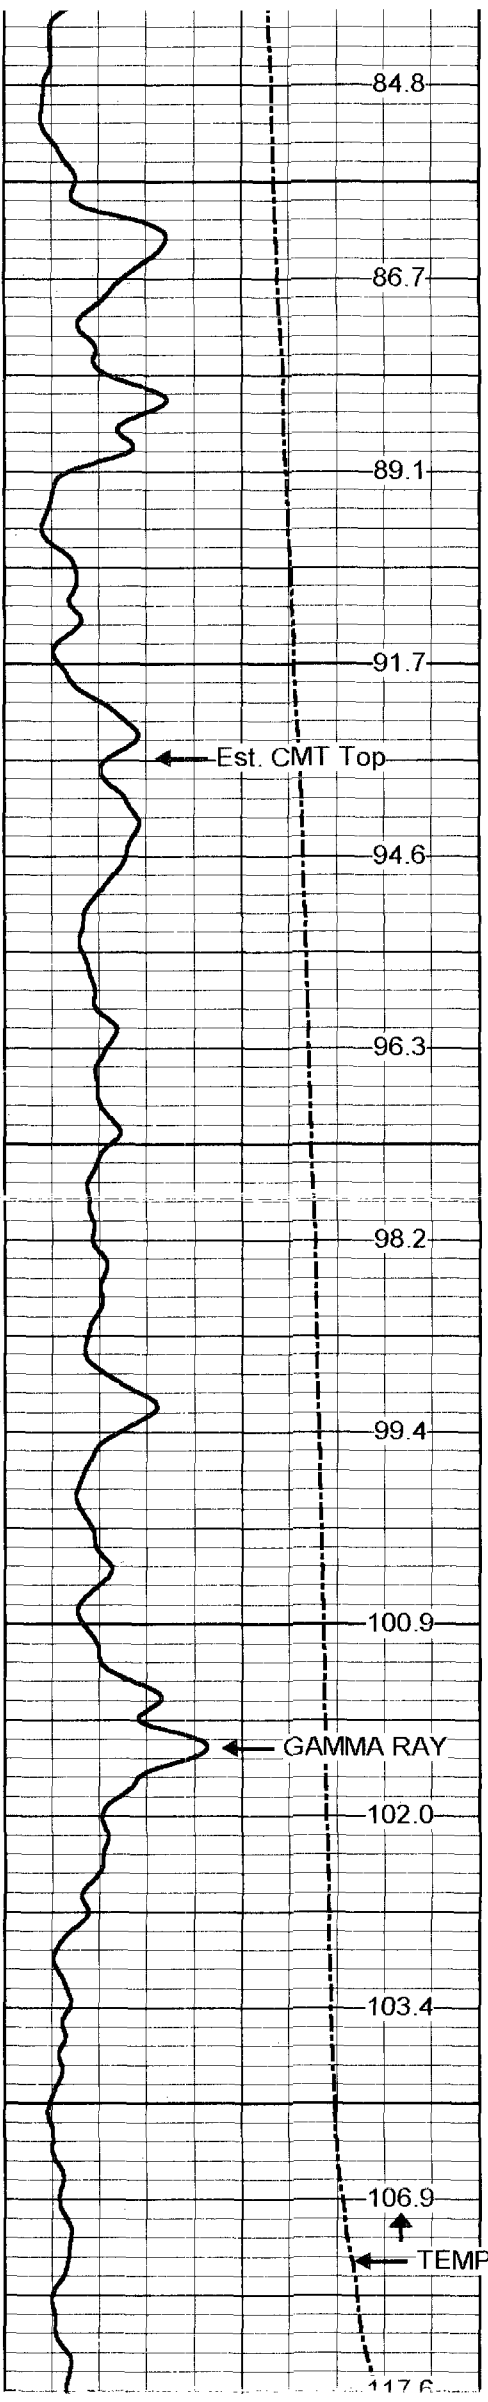

300


400

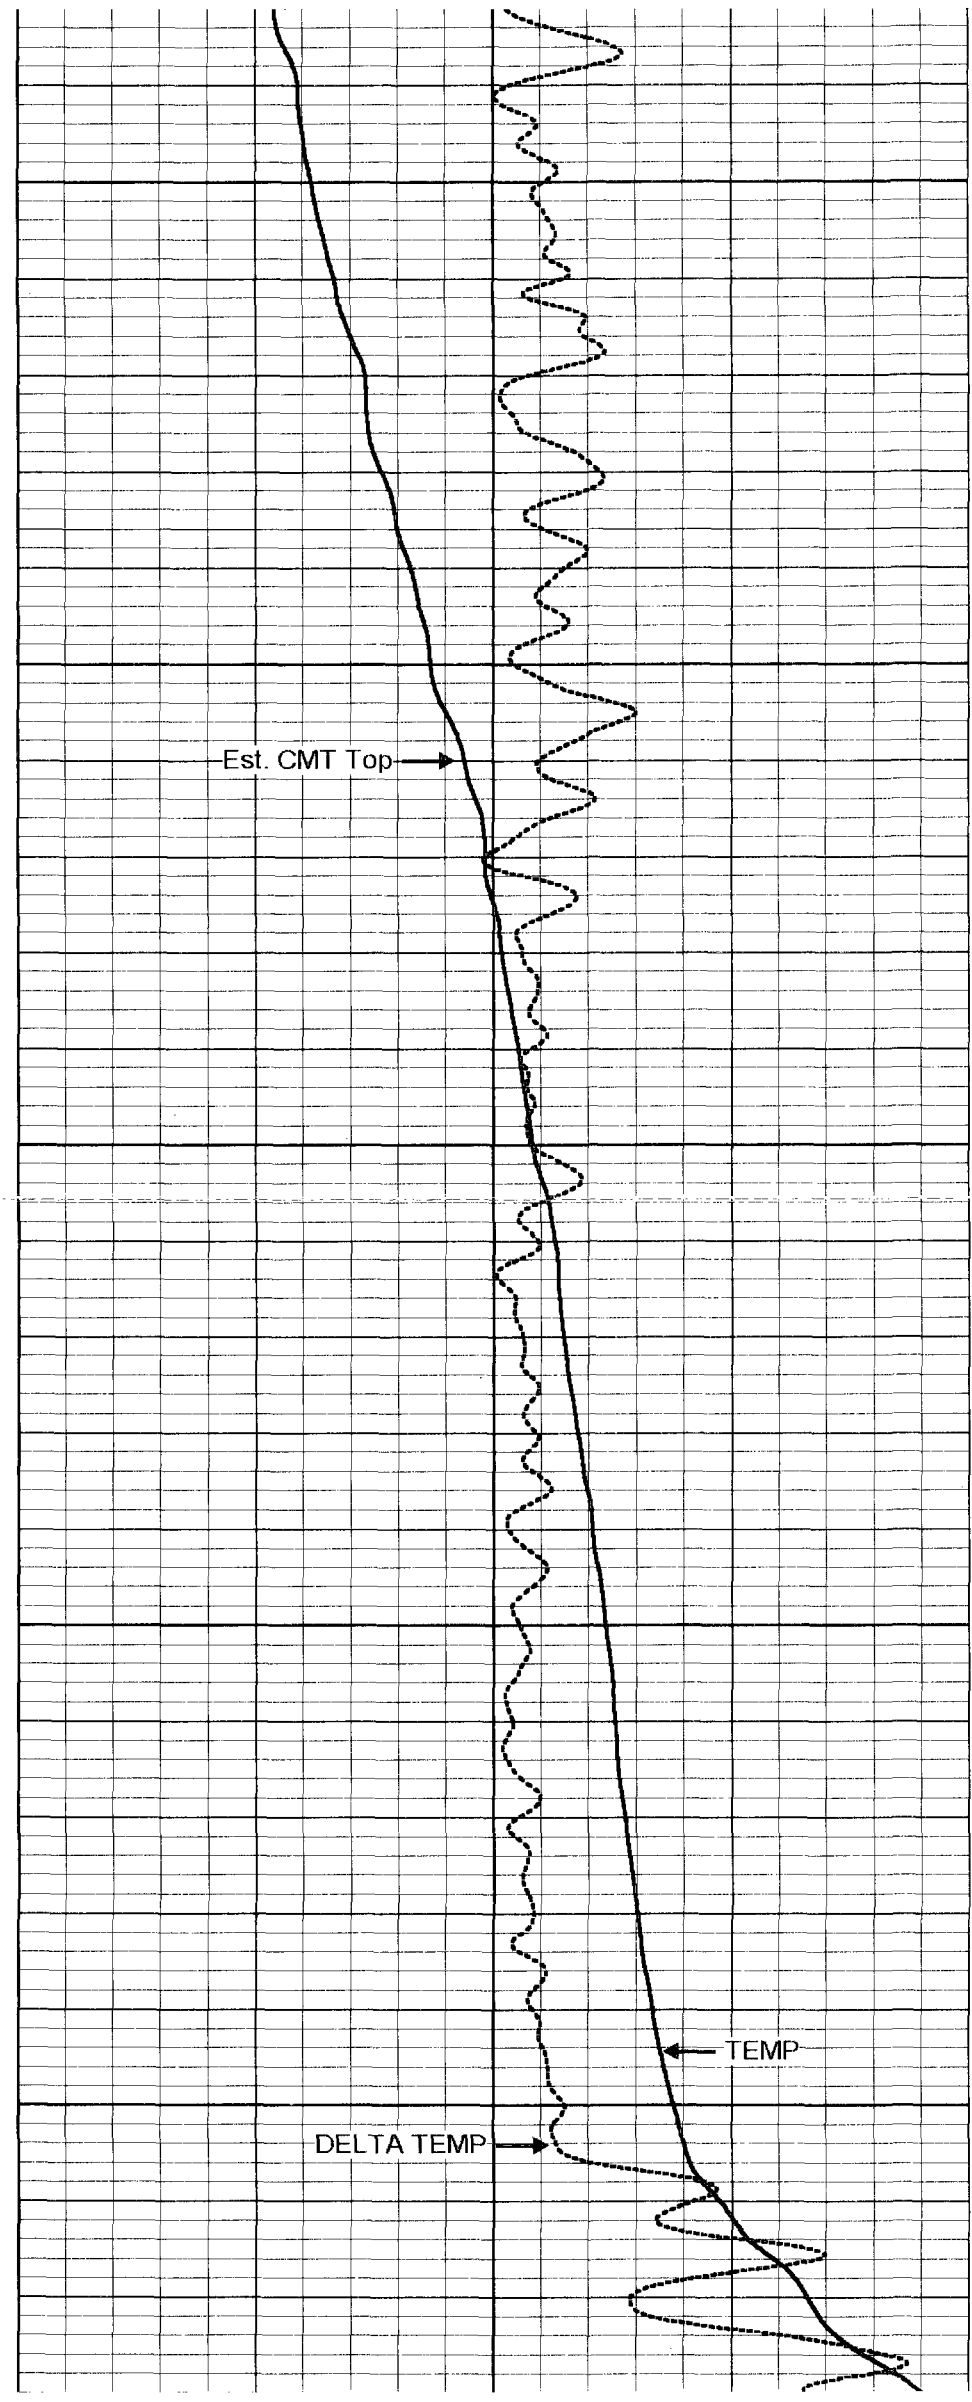

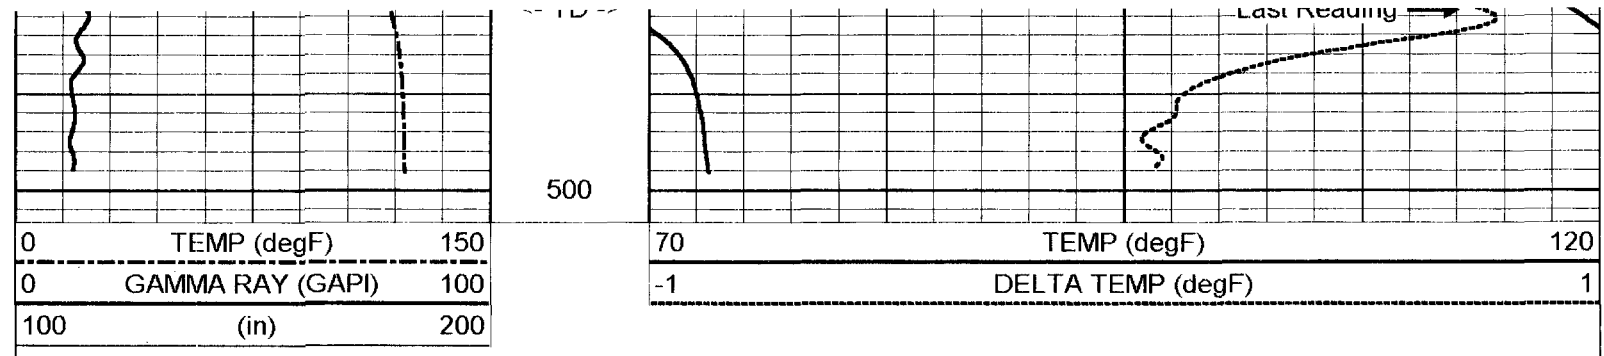

Gamma Ray Calibration Report

Serial Number:	MV01B	
Tool Model:	RTSB	
Performed:	Wed Mar 22 07:24:49 2000	
Calibrator Value:	120	GAPI
Background Reading:	30.1577	cps
Calibrator Reading:	206.285	cps
Sensitivity:	0.681325	GAPI/cps

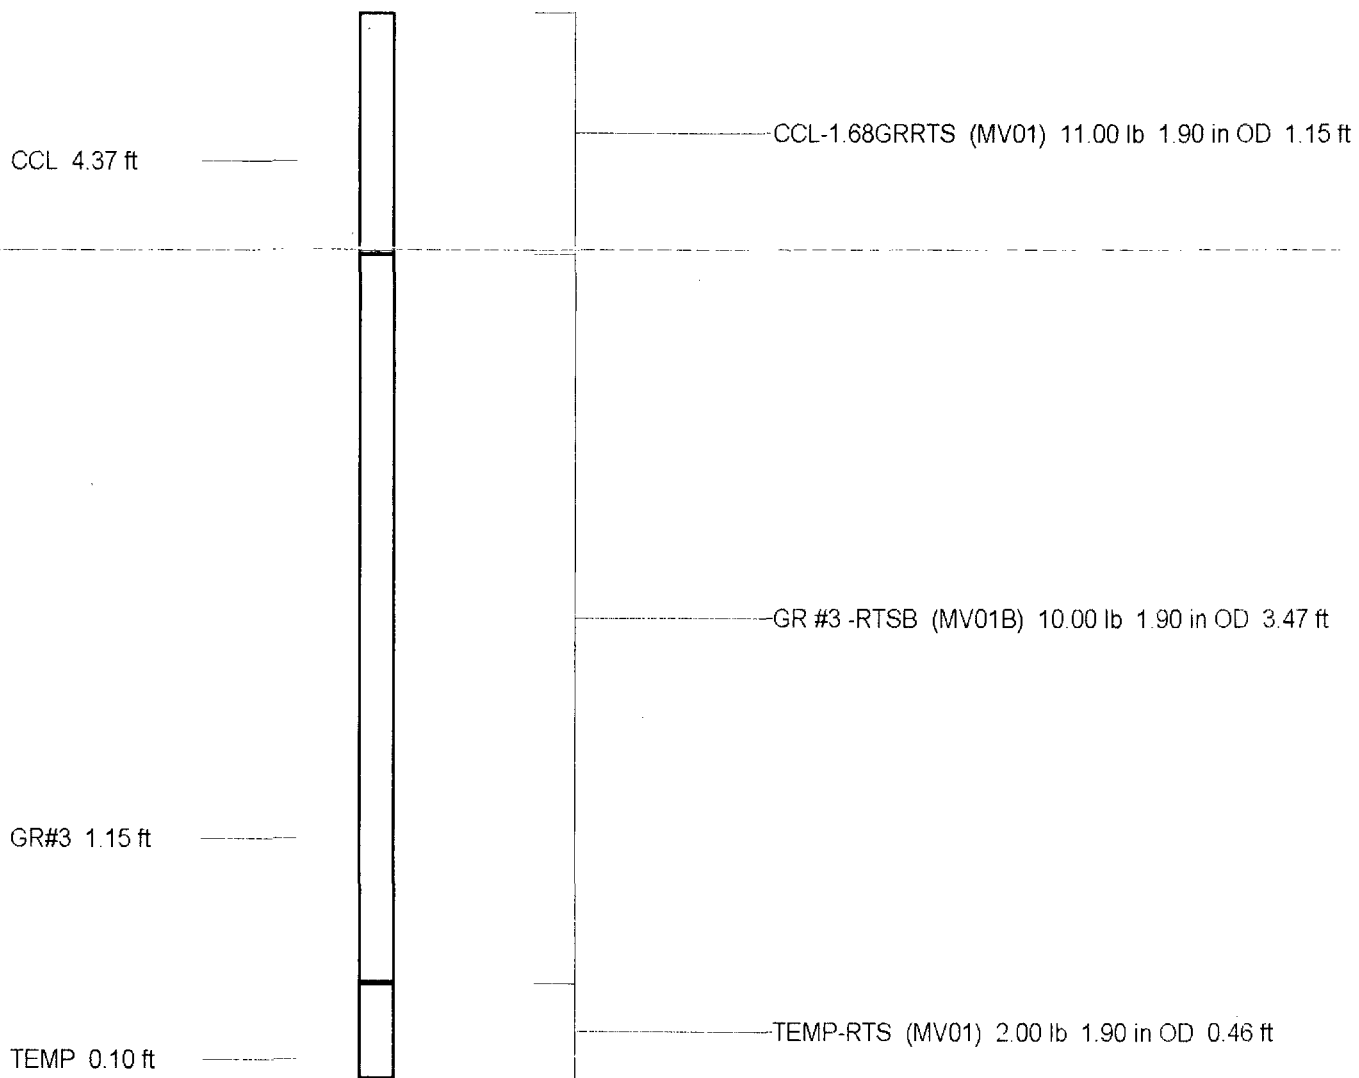

Dataset: run1/pass2
 Total Length: 5.08 ft
 Total Weight: 23.00 lb
 O.D.: 1.90 in