



FLUID CONDUCTIVITY
RECEIVED TEMPERATURE
LOG
DEPT
SOUTH DISTRICT

Company Diversified Drilling Corp.
Well Pelican Bay ASR-1
Field Naples
County Collier
State/Prv Florida

Company Diversified Drilling Corporation
Well Pelican Bay ASR-1
Field Naples
County Collier
State/Prv Florida

Location Livingston Road
Pelican Bay ASR Site
Water Resource Solutions, Inc.

Permanent Datum G.L.
Log Measured From G.L.
Drilling Measured From G.L.

Elevation
FLOW
FCT
Other Services
Elevation
K.B.
D.F.
G.L.

Date	5-SEP-2006	
Run Number	SEVEN	
Depth Driller	862'	
Depth Logger	863'	
Bottom Logged Interval	863'	
Top Log Interval	745'	
Open Hole Size	12.25"	
Type Fluid	H2O	
Density / Viscosity	NANA	
Max Recorded Temp	see FCT log	
Estimated Cement Top	NA	
Time Well Ready	10:00 9/1/2006	
Time Logger on Bottom	10:00 9/1/2006	
Equipment Number	MVG-S-1	
Location	Ft. Myers	
Recorded By	S. Miller	
Witnessed By	A.McThenia (WRS)	
	C.Sappington (DDC)	
	T.T. (DDC)	
Borehole Record		
Run Number	Bit	From
ONE	12.25"	39'
TWO	32"	39'
THREE	12.25"	320'
FOUR	12.25"	320'
Casing Record	Size	Wgt/Ft
Surface String	34"	375" WT
Prot. String	26"	375" WT
Production String		
Liner		
Invoice No.	2006262	
P.O. #	61071	
Job No.	6604	
		* FINAL PRINT *

<<< Fold Here >>>

All interpretations are opinions based on inferences from electrical or other measurements and we cannot and do not guarantee the accuracy or correctness of any interpretation, and we shall not, except in the case of gross or willful negligence on our part, be liable or responsible for any loss, costs, damages, or expenses incurred or sustained by anyone resulting from any interpretation made by any of our officers, agents or employees. These interpretations are also subject to our general terms and conditions set out in our current Price Schedule.

Comments


A DYNAMIC DOWN pass was performed.
Cw=9170 uS/cm @ 86.7 degF (Dynamic Sample). Q = ~320 gpm.
FLUID RESISTIVITY CALIBRATION REPORT (Performed: 22-JULY-06 12:45)

uS/cm	CPS
3033.25	2921.17
5822.2	2562.58
14871.8	2219.58

TEMPERATURE CALIBRATION REPORT (Performed: 22-JULY-06 12:15)



DEG-F	CPS
34.4	2345.78
143.1	6968.24

Packer Set @ 800'

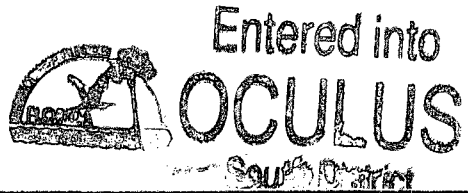

DYNAMIC FCT DOWN

Database File: pbasr-1.db
Dataset Pathname: run7/DFCT
Presentation Format: fctpbay3.prs
Dataset Creation: Tue Sep 05 19:03:55 2006
Charted by: Depth in Feet scaled 1:240

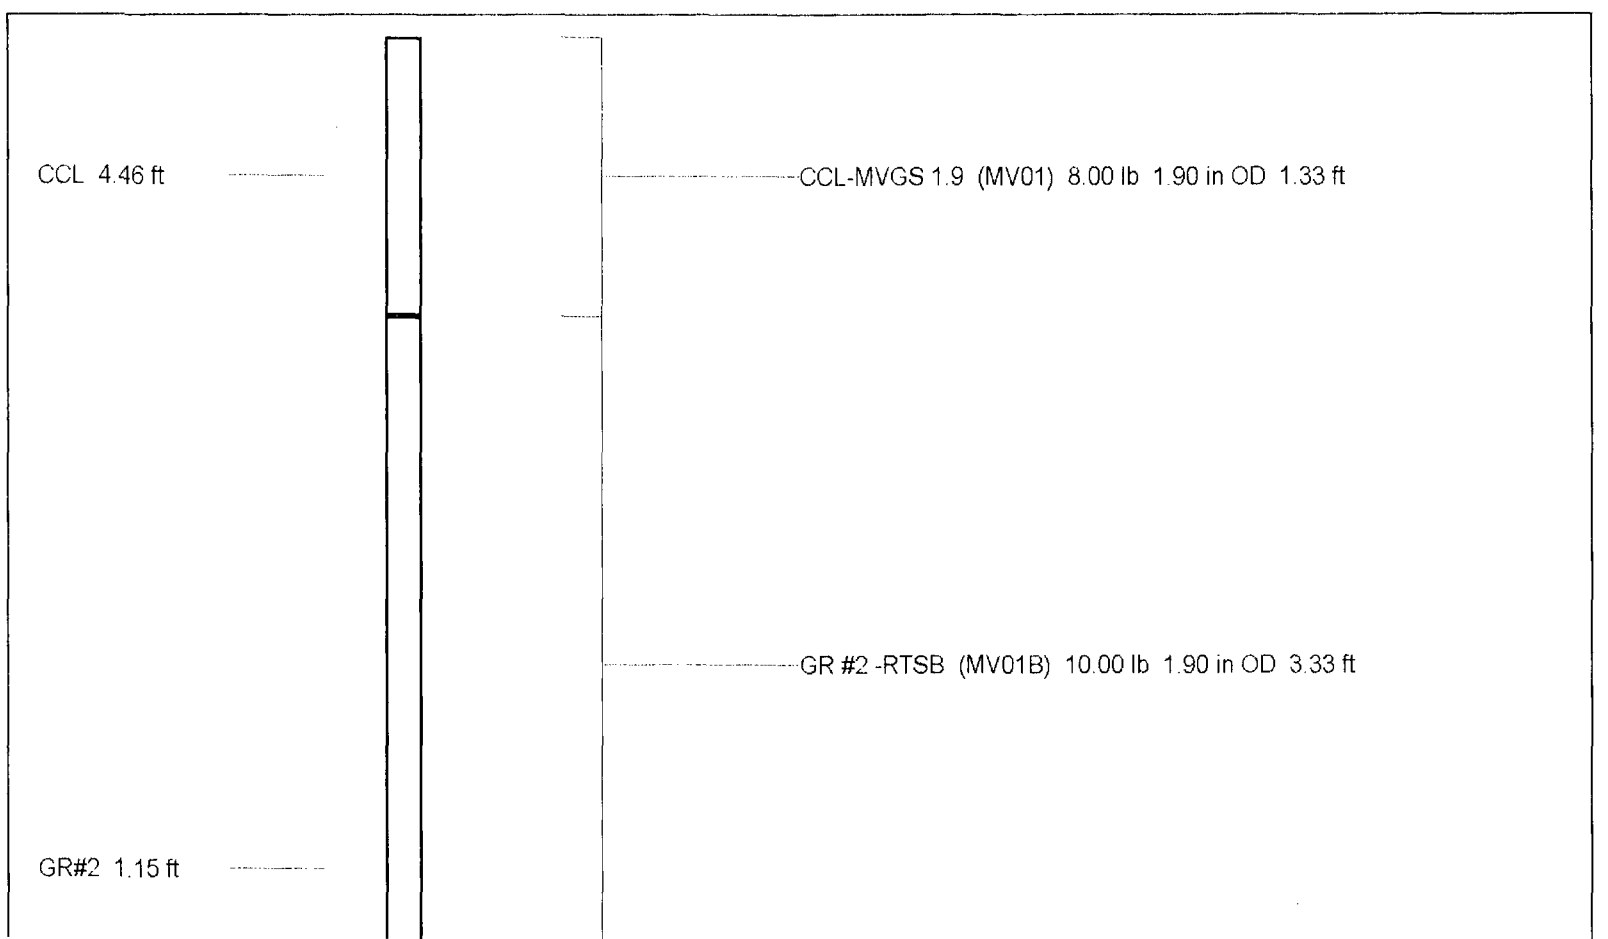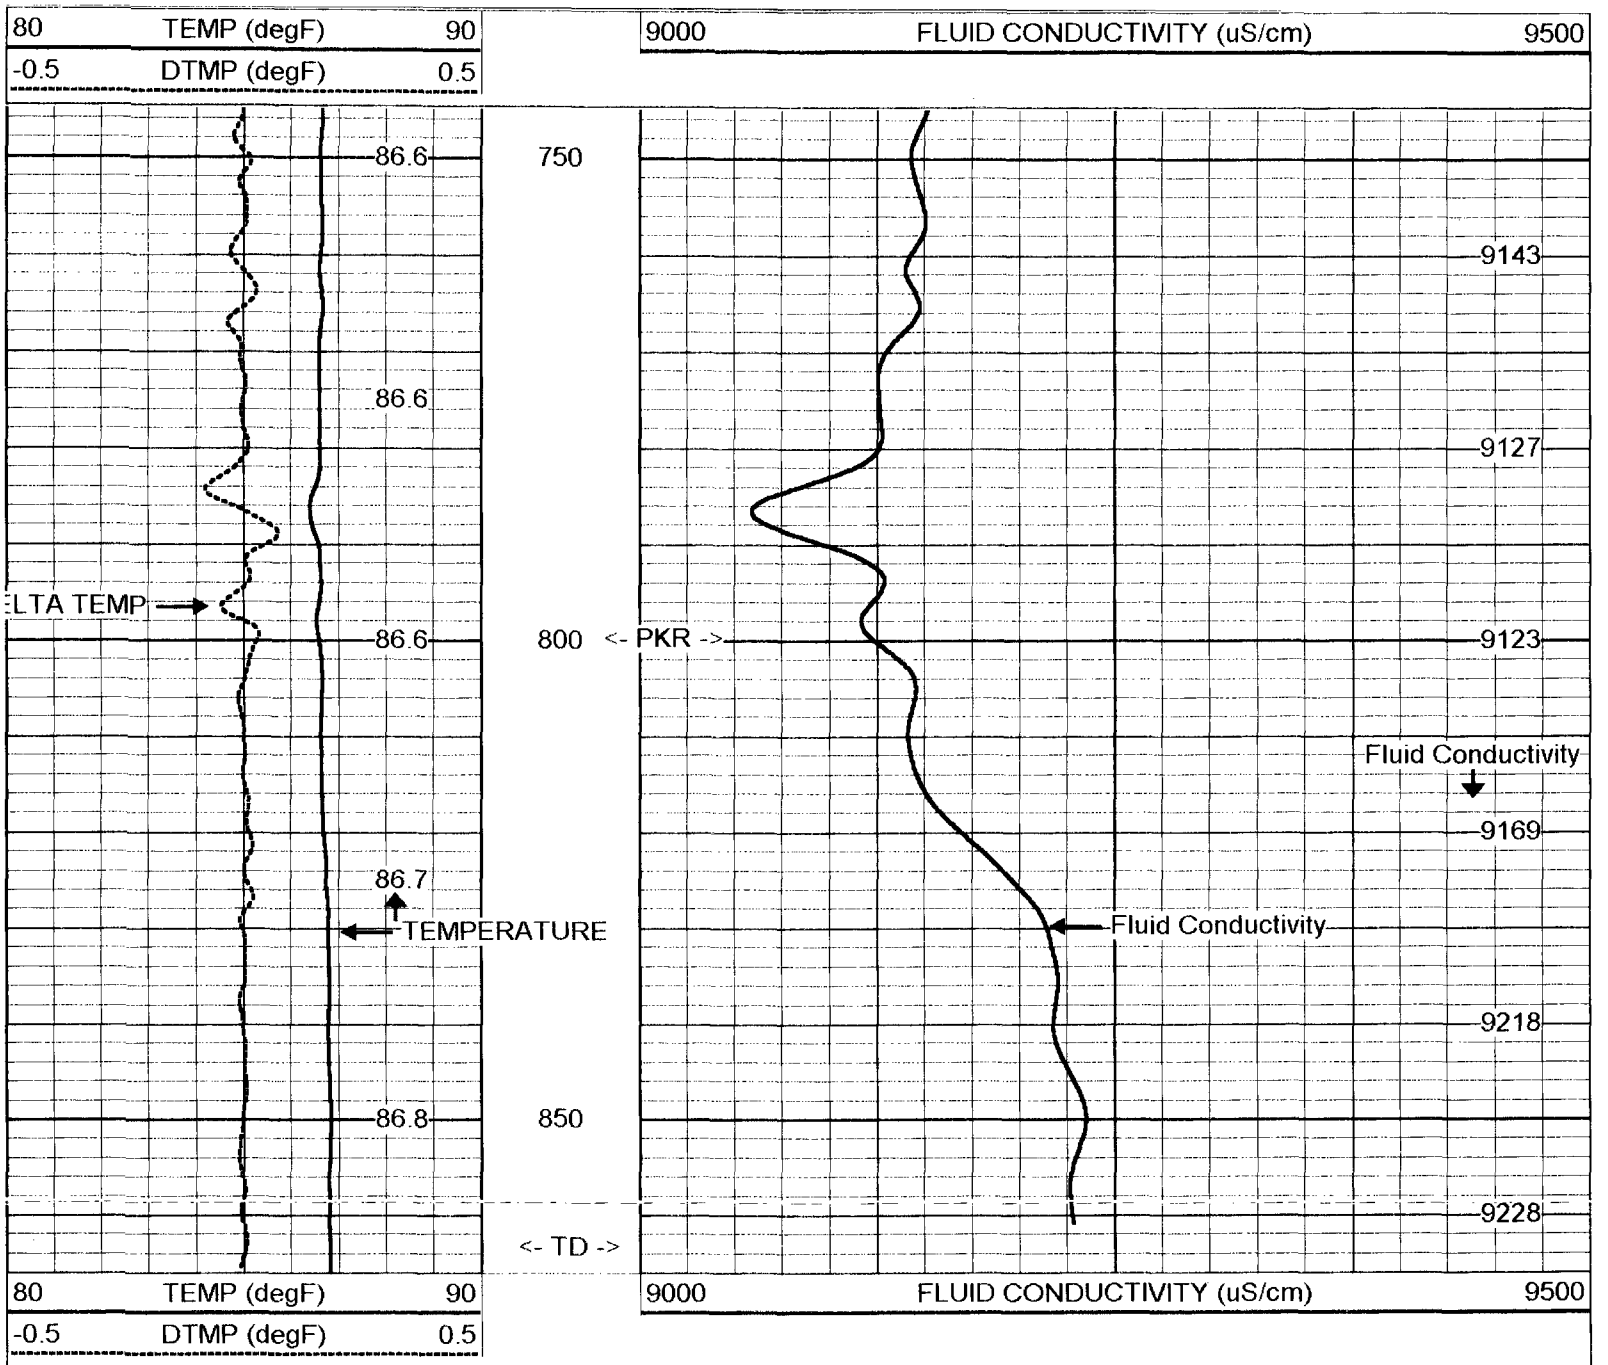

TEMP 0.10 ft



TEMP-RTS (MV01) 2.00 lb 1.90 in OD 0.46 ft

Dataset:	run4/pass3.4
Total Length:	5.12 ft
Total Weight:	20.00 lb
O.D.	1.90 in